**915SA**
**LEGACY LINE SINGLE−STAGE**
**4−WAY MULTIPOISE**
**CONDENSING GAS FURNACE**

# Product Data

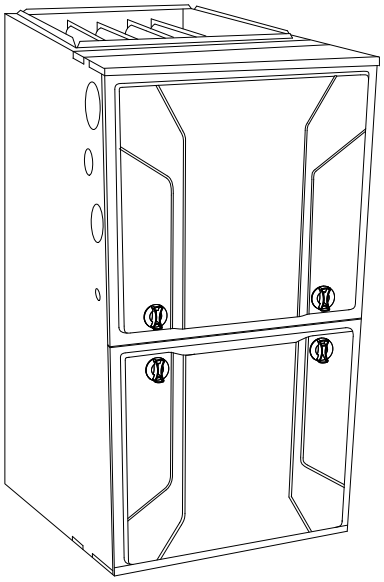

A11264

The 915S Multipoise Condensing Gas Furnace is part of the Legacy Line product offering. Sporting a PSC blower motor and an Annual Fuel Utilization Efficiency (AFUE) up to 96.0%, this single-stage gas furnace provides efficient comfort for homeowners. This Legacy Line Gas Furnace also features 4-way multipoise installation flexibility, and is available in eleven model sizes. All sizes except the 26,000 BTUH model can be vented for direct vent/two-pipe, ventilated combustion air, or single-pipe applications. The 26,000 BTUH model can use the same 2−pipe venting system using outside air for combustion, but is not considered direct−vent. A Bryant® Air Conditioner or Heat Pump can be used to form a complete system. Low NOx units are designed for California installations and meet 40 ng/J NOx emissions. Can be installed in air quality management districts with a 40 ng/J NOx emissions requirement. These furnaces are approved for Manufactured Housing (Mobile Home) applications. All sizes are design certified in Canada.

## STANDARD FEATURES

- 4-way multipoise design for upflow, downflow or horizontal installation.
- Optional through-the-cabinet downflow venting.
- Installation flexibility with a 360-degree rotating elbow.
- Ideal condensing furnace height 35” (889 mm) cabinet: short enough for taller coils, but still allows enough room for service.
- Silicon Nitride Perfect Light™ Hot Surface Igniter.
- Aluminized-steel primary heat exchanger.
- Stainless-steel condensing secondary heat exchanger.
- High-quality corrosion-resistant prepainted steel cabinet with hemmed edges for safety.
- Factory-configured ready for upflow applications.
- Direct-vent/sealed combustion, single-pipe venting or ventilated combustion air.
- PSC blower motor, single-speed inducer motor, and single-stage gas valve.
- Self-diagnostics
- Approved for Twinning applications (42060 through 60120 sizes, only).
- Propane convertible (See accessory list).
- Approved for Manufactured Housing/Mobile Home applications (except 26,000 and 140,000 Btuh input) with MH accessory kit.
- Convenient Air Purifier and Humidifier electrical connections.
- Residential installations may be eligible for consumer financing through the Retail Credit Program.
- Cabinet air leakage less than 2.0% at 1.0 in. W.C. and cabinet air leakage less than 1.4% at 0.5 in. W.C. when tested in accordance with ASHRAE standard 193.

LEGACY LINE

Certified System ISO 9001 QMI-SAI Global

AHRI CERTIFIED www.ahridirectory.org

Use of the AHRI Certified ™ Mark indicates a manufacturer’s participation in the program. For verification of certification for individual products, go to www.ahridirectory.org.

DESIGN CERTIFIED ®

CERTIFIED ®

EASE OF INSTALLATION FACTORY AUTHORIZED PARTS ENGINEERED QUALITY

| SAP ORDERING NO. | CASING DIMENSIONS (IN.) | | | RATED HEATING OUTPUT† | AFUE | | ENERGY STAR® | HEATING AIRFLOW | | COOLING CFM @ 0.5 ESP (in. W.C.) | MOTOR HP SPEED TAPS |
|---|---|---|---|---|---|---|---|---|---|---|---|
| | H | D | W | (BTUH) | UPFLOW/ HORIZONTAL | DOWNFLOW | | CFM‡ | HEATING ESP (in. W.C.) | | |
| 915SA24026S14 | 35 | 29.5 | 14.2 | 25,000 | 96.0% | 96.0% | None | 675 | 0.10 | 440-775 | 1/4 - 4 |
| 915SA30040S14 | 35 | 29.5 | 14.2 | 39,000 | 96.0% | 96.0% | None | 820 | 0.10 | 625-905 | 1/2 - 4 |
| 915SA36040S17 | 35 | 29.5 | 17.5 | 39,000 | 96.0% | 96.0% | None | 1000 | 0.10 | 650-1050 | 1/2 - 5 |
| 915SA30060S14 | 35 | 29.5 | 14.2 | 58,000 | 96.0% | 96.0% | None | 840 | 0.12 | 675-1130 | 1/2 - 4 |
| 915SA42060S17 | 35 | 29.5 | 17.5 | 58,000 | 96.0% | 96.0% | None | 980 | 0.12 | 650-1420 | 1/2 - 5 |
| 915SA48080S17 | 35 | 29.5 | 17.5 | 78,000 | 96.0% | 96.0% | None | 1040 | 0.15 | 810-1600 | 3/4 - 5 |
| 915SA60080S21 | 35 | 29.5 | 21.0 | 78,000 | 96.0% | 96.0% | None | 1695 | 0.15 | 1335-1970 | 1 - 5 |
| 915SA42100S21 | 35 | 29.5 | 21.0 | 97,000 | 96.0% | 96.0% | None | 1510 | 0.20 | 915–1545 | 1/2 - 4 |
| 915SA60100S21 | 35 | 29.5 | 21.0 | 97,000 | 96.0% | 96.0% | None | 1680 | 0.20 | 1345–2065 | 1 - 5 |
| 915SA60120S24 | 35 | 29.5 | 24.5 | 117,000 | 96.0% | 96.0% | None | 2245 | 0.20 | 1320-2105 | 1 - 5 |
| 915SA60140S24 | 35 | 29.5 | 24.5 | 135,000 | 96.0% | 96.0% | None | 2175 | 0.20 | 1290–2035 | 1 - 5 |

† Capacity in accordance with DOE test procedures. Ratings are position dependent. See rating plate.
‡ Heating CFM at factory default blower motor heating tap settings.
ESP – External Static Pressure



## FEATURES AND BENEFITS

**HYBRID HEAT® Dual Fuel system** — This system can provide more control over your monthly energy bills by automatically selecting the most economical method of heating. With HYBRID HEAT components, our system automatically switches between the gas furnace and the single–stage electric heat pump as outside temperatures change to maintain greater efficiency and comfort than with any traditional single-source heating system. The heat pump also delivers high-efficiency cooling in the summer.

**Perfect Light™ Igniter** — Bryant's unique SiN igniter is not only physically robust but it is also electrically robust. It is capable of running at line voltage and does not require complex voltage regulators as do other brands. This unique feature further enhances the gas furnace reliability and continues Bryant's tradition of technology leadership and innovation in providing a reliable and durable product.

**Reliable Heat Exchanger Design** — The aluminized steel, clam shell primary heat exchanger was re–engineered to achieve greater efficiency out of a smaller size. The first two passes of the heat exchanger are based on the current 80% product, a design with more than ten years of field-proven performance and success. These innovations, paired with the continuation of a crimped, no-weld seam create an efficient, robust design for this essential component.

The condensing heat exchanger, a stainless steel fin and tube design, is positioned in the furnace to extract additional heat. Stainless steel coupling box componentry between heat exchangers has exceptional corrosion resistance in both natural gas and propane applications.

**4-Way Multipoise Design** — One model for all applications – there is no need to stock special downflow or horizontal models when one unit will do it all. The new heat exchanger design allows these units to achieve the certified AFUE in all positions.

**Direct or Single-pipe Venting, or Optional Ventilated Combustion Air** — All sizes except the 26,000 BTUH model can be vented for direct vent/two-pipe, ventilated combustion air, or single-pipe applications. The 26,000 BTUH model can use the same 2–pipe venting system using outside air for combustion, but is not considered direct–vent. This provides added flexibility to meet diverse installation needs.

**Sealed Combustion System** — This furnace brings in combustion air from outside the furnace, which results in especially quiet operation. By sealing the entire combustion vestibule, the entire furnace can be made quieter, not just the burners.

**Monoport Burners** — The burners are specially designed and finely tuned for smooth, quiet combustion and economical operation.

**Bottom Closure** — Factory-installed for side return; easily removable for bottom return. The multi-use bottom closure can also serve for roll-out protection in horizontal applications, and act as the bottom closure for the optional return air base accessory.

**Blower Access Panel Switch** — Automatically shuts off 115-v power to furnace whenever blower access panel is opened.

**Quality Registration** — Our furnaces are engineered and manufactured under an ISO 9001 registered quality system.

**Certifications** — This furnace is CSA (AGA and CGA) design certified for use with natural and propane gases. The furnace is factory–shipped for use with natural gas. A CSA listed gas conversion kit is required to convert furnace for use with propane gas. The efficiency is AHRI efficiency rating certified. This furnace meets California Air Quality Management District emission requirements.

# SPECIFICATIONS

The furnace should be sized to provide 100 percent of the design heating load requirement plus any margin that occurs because of furnace model size capacity increments. None of the furnace model sizes can be used if the heating load is 12,000 BTUH or lower. Use Air Conditioning Contractors of America (Manual J and S); American Society of Heating, Refrigerating, and Air-Conditioning Engineers; or other approved engineering method to calculate heating load estimates and select the furnace. Excessive oversizing of the furnace may cause the furnace and/or vent to fail prematurely, customer discomfort and/or vent freezing.

Failure to follow these guidelines is considered faulty installation and/or misapplication of the furnace; and resulting failure, damage, or repairs may impact warranty coverage.

| **Heating Capacity and Efficiency** | | | **24026** | **30040** | **36040** | **30060** | **42060** | **48080** | **60080** | **42100** | **60100** | **60120** | **60140** |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Input | High Heat | (BTUH) | 26,000 | 40,000 | 40,000 | 60,000 | 60,000 | 80,000 | 80,000 | 100,000 | 100,000 | 120,000 | 140,000 |
| Output | High Heat | (BTUH) | 25,000 | 39,000 | 39,000 | 58,000 | 58,000 | 78,000 | 78,000 | 97,000 | 97,000 | 117,000 | 135,000 |
| Certified Temperature Rise Range °F (°C) | | High Heat | 25 - 55 (14 - 31) | 40 - 70 (22 - 39) | 35 - 65 (19 - 36) | 40 - 70 (22 - 39) | 40 - 70 (22 - 39) | 40 - 70 (22 - 39) | 40 - 70 (22 - 39) | 40 - 70 (22 - 39) | 40 - 70 (22 - 39) | 40 - 70 (22 - 39) | 45 - 75 (25 - 42) |

| **Airflow Capacity and Blower Data** | | **24026** | **30040** | **36040** | **30060** | **42060** | **48080** | **60080** | **42100** | **60100** | **60120** | **60140** |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Rated External Static Pressure (in. W.C.) | Heating | 0.10 | 0.10 | 0.10 | 0.12 | 0.12 | 0.15 | 0.15 | 0.20 | 0.20 | 0.20 | 0.20 |
| | Cooling | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 | 0.5 |
| Airflow Delivery @ Rated ESP (CFM) | High Heat | 675 | 820 | 1000 | 840 | 980 | 1040 | 1695 | 1510 | 1680 | 2245 | 2175 |
| | Cooling | 775 | 905 | 1050 | 1130 | 1420 | 1600 | 1970 | 1545 | 2065 | 2105 | 2035 |
| Cooling Capacity (tons) | 400 CFM/ton | 1.5 | 2 | 2.5 | 2.5 | 3.5 | 4 | 5 | 4 | 5 | 5 | 5 |
| | 350 CFM/ton | 2 | 2.5 | 3 | 3 | 4 | 4.5 | 5.5 | 4.5 | 6 | 6 | 6 |
| Direct-Drive Motor Type | | Permanent Split Capacitor (PSC) | | | | | | | | | | |
| Direct-Drive Motor HP | | 0.25 | 0.5 | 0.5 | 0.5 | 0.5 | 0.75 | 1 | 0.5 | 1 | 1 | 1 |
| Motor Full Load Amps | | 2.8 | 6.2 | 6.8 | 6.2 | 6.8 | 7.9 | 13.8 | 6.5 | 13.8 | 14.1 | 14.1 |
| RPM Range | | 500 -1150 | | | | | | | | | | |
| Speed Selections | | 4 | 4 | 5 | 4 | 5 | 5 | 5 | 4 | 5 | 5 | 5 |
| Blower Wheel Dia x Width | in. | 11 x 7 | 11 x 7 | 11 x 8 | 11 x 7 | 11 x 8 | 11 x 8 | 11 x 10 | 11 x 10 | 11 x 10 | 11 x 11 | 11 x 11 |
| Air Filtration System | | Field Supplied | | | | | | | | | | |
| Filter Used for Certified Watt Data* | | KGAWF**06UFR | | | | | | | | | | |

| **Electrical Data** | | **24026** | **30040** | **36040** | **30060** | **42060** | **48080** | **60080** | **42100** | **60100** | **60120** | **60140** |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Input Voltage | Volts-Hertz-Phase | 115-60-1 | | | | | | | | | | |
| Operating Voltage Range | Min-Max | 104-127 | | | | | | | | | | |
| Maximum Input Amps | Amps | 3.6 | 6.8 | 8.3 | 7.0 | 8.4 | 9.6 | 14.5 | 7.6 | 14.6 | 14.9 | 14.9 |
| Unit Ampacity | Amps | 5.4 | 9.5 | 11.4 | 9.7 | 11.5 | 13.0 | 19.1 | 10.4 | 19.2 | 19.6 | 19.6 |
| Minimum Wire Size | AWG | 14 | 14 | 14 | 14 | 14 | 14 | 12 | 14 | 12 | 12 | 12 |
| Maximum Wire Length @ Minimum Wire Size | Feet | 68 | 39 | 32 | 38 | 32 | 28 | 30 | 35 | 29 | 29 | 29 |
| | (M) | (20.7) | (11.9) | (9.8) | (11.6) | (9.8) | (8.5) | (9.1) | (10.7) | (8.8) | (8.8) | (8.8) |
| Maximum Fuse/Ckt Bkr (Time-Delay Type Recommended) | Amps | 15 | 15 | 15 | 15 | 15 | 15 | 20 | 15 | 20 | 20 | 20 |
| Transformer Capacity (24vac output) | | 40 VA | | | | | | | | | | |
| External Control Power Available | Heating | 27.9 VA | | | | | | | | | | |
| | Cooling | 34.6 VA | | | | | | | | | | |

| **Controls** | | **24026** | **30040** | **36040** | **30060** | **42060** | **48080** | **60080** | **42100** | **60100** | **60120** | **60140** |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Gas Connection Size | | 1/2" - NPT | | | | | | | | | | |
| Burners (Monoport) | | 2 | 2 | 2 | 3 | 3 | 4 | 4 | 5 | 5 | 6 | 7 |
| Gas Valve (Redundant) | Manufacturer | White Rogers | | | | | | | | | | |
| Minimum Inlet Gas pressure (in. W.C.) | | 4.5 | | | | | | | | | | |
| Maximum Inlet Gas pressure (in. W.C.) | | 13.6 | | | | | | | | | | |
| Ignition Device | | Silicon Nitride | | | | | | | | | | |
| Limit Control | | 220 | 165 | 180 | 165 | 180 | 170 | 200 | 180 | 180 | 160 | 155 |
| Heating Blower Control (Heating Off-Delay) | | Adjustable: 90, 120, 150, 180 seconds | | | | | | | | | | |
| Cooling Blower Control (Time Delay Relay) | | 90 seconds | | | | | | | | | | |
| Communication System | | *none* | | | | | | | | | | |
| Thermostat Connections | | Com 24V, R, W, G, Y | | | | | | | | | | |
| Accessory Connections | | EAC (115vac); HUM (24vac) | | | | | | | | | | |

* See Accessory List for part numbers available.

# MODEL NUMBER NOMENCLATURE

| 1-2 Family | 3 Base Eff. | 4 Htg. Stages | 5 Major Series | 6 - 7 Clg. Cap. | 8 - 10 Htg. Cap. | 11 Motor | 12 - 13 Width | 14 Voltage | 15 Features | 16 Minor Series |
|---|---|---|---|---|---|---|---|---|---|---|
| 91 | 5 | S | A | 30 | 060 | S | 14 | A | - | A |
| 91 - Legacy<br>92 - Preferred<br>98 - Evolution | 0 - +90 AFUE<br>2 - +92 AFUE<br>3 - +93 AFUE<br>5 - +95 AFUE<br>6 - +96 AFUE<br>7 - +97 AFUE | S - Single Stage<br>T - Two Stage<br>M - Modulating | Major Series | 24 - 800 CFM<br>30 - 1000 CFM<br>36 - 1200 CFM<br>42 - 1400 CFM<br>48 - 1600 CFM<br>54 - 1800 CFM<br>60 - 2000 CFM<br>66 - 2200 CFM | 026 = 26,000 BTU<br>040 = 40,000 BTU<br>060 = 60,000 BTU<br>080 = 80,000 BTU<br>100 = 100,000 BTU<br>120 = 120,000 BTU<br>140 = 140,000 BTU | S - Standard<br>E- Energy Efficient<br>V - Variable Speed | 14 - 14.2"<br>17 - 17.5"<br>21 - 21.0"<br>24 - 24.5" | Voltage | L - Low Nox | Minor Series |

A180003

**For California Residents:**
For installation in SCAQMD only: This furnace does not meet the SCAQMD Rule 1111 14 ng/J NOx emission limit, and thus is subject to a mitigation fee of up to $450. This furnace is not eligible for the Clean Air Furnace Rebate Program: www.CleanAirFurnaceRebate.com



# FURNACE COMPONENTS

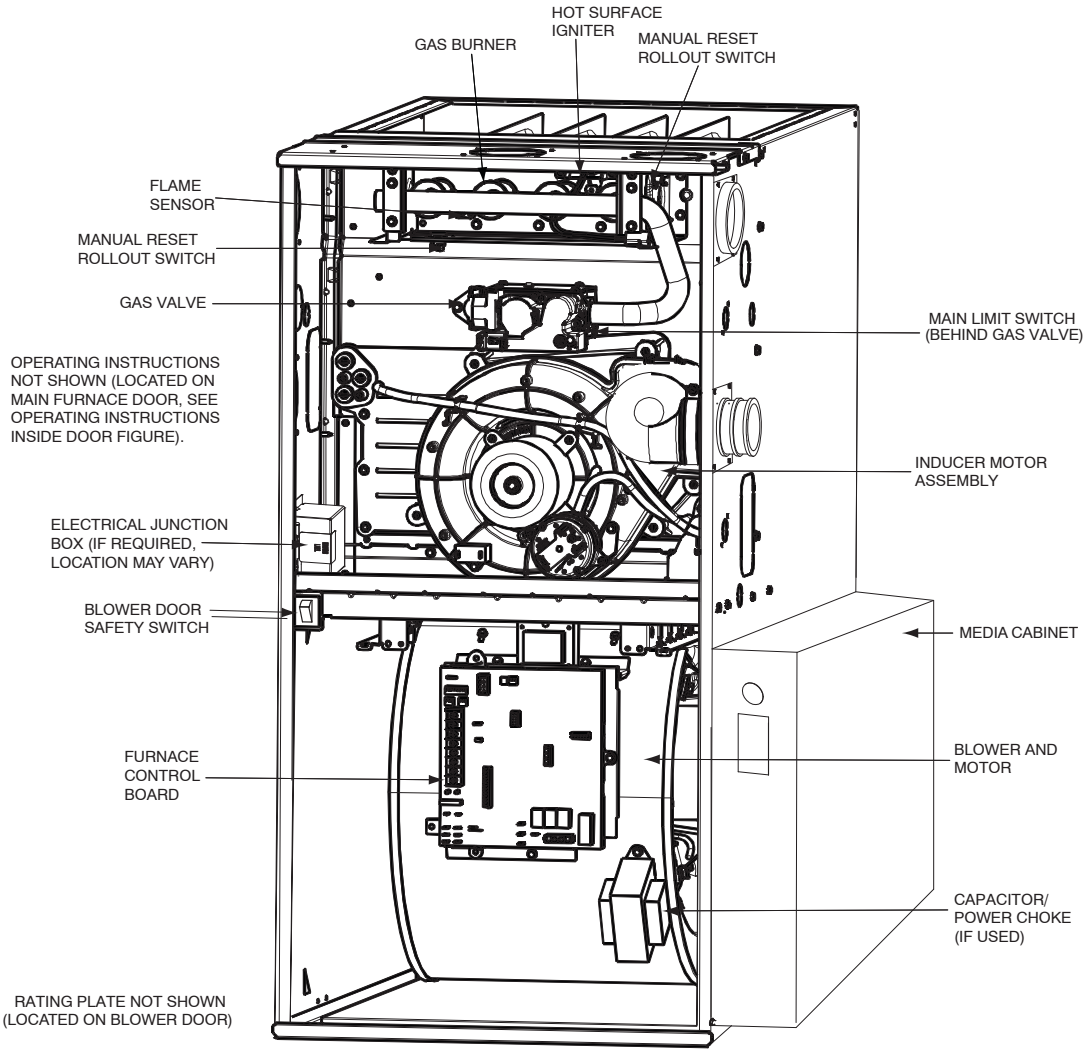


REPRESENTATIVE DRAWING ONLY, SOME MODELS MAY VARY IN APPEARANCE.

A170154

# ACCESSORIES

| DESCRIPTION | PART NUMBER | 24026 | 30040 | 36040 | 30060 | 42060 | 48080 | 60080 | 42100 | 60100 | 60120 | 60140 |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| **Venting Accessories** | | | | | | | | | | | | |
| Vent Kit - Through the Cabinet | KGADC0101BVC | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Vent Terminal - Concentric - 2" (51 mm) | KGAVT0701CVT | See Venting Tables | | | | | | | | | | |
| Vent Terminal - Concentric - 3" (76 mm) | KGAVT0801CVT | | | | | | | | | | | |
| Vent Terminal Bracket - 2" (51 mm) | KGAVT0101BRA | | | | | | | | | | | |
| Vent Terminal Bracket - 3" (76 mm) | KGAVT0201BRA | | | | | | | | | | | |
| Vent Kit — Rubber Coupling | KGAAC0101RVC | See Venting Tables | | | | | | | | | | |
| **Condensate Drainage Accessories** | | | | | | | | | | | | |
| Freeze Protect Kit — Trap Heater | KGAHT0201CFP | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| CPVC to PVC Drain Adapters - 1/2" CPVC to 3/4" PVC | KGAAD0110PVC | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Horizontal Trap Grommet - Direct Vent | KGACK0101HCK | All 2—Pipe Horizontal | | | | | | | | | | |
| Condensate Neutralizer Kit | P908—0001 | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| External Trap Kit | KGAET0201ETK | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| **Ductwork Adapter Accessories** | | | | | | | | | | | | |
| Furnace Base Kit for Combustible Floors | KGASB0201ALL | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Coil Adapter Kits — No Offset | KGADA0101ALL | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Coil Adapter Kits — Single Offset | KGADA0201ALL | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Coil Adapter Kits — Double Offset | KGADA0301ALL | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Return Air Base (Upflow Applications) 14.0—in. wide | KGARP0301B14 | ● | ● | ● | | | | | | | | |
| Return Air Base (Upflow Applications) 17.5—in. wide | KGARP0301B17 | | | | ● | ● | ● | | | | | |
| Return Air Base (Upflow Applications) 21.0—in. wide | KGARP0301B21 | | | | | | | ● | ● | ● | | |
| Return Air Base (Upflow Applications) 24.5—in. wide | KGARP0301B24 | | | | | | | | | | ● | ● |
| IAQ Device Duct Adapters 20.0—in. IAQ to 16 in. Side Return | KGAAD0101MEC | 20"x25" IAQ Devices | | | | | | | | | | |
| IAQ Device Duct Adapters 24.0—in. IAQ to 16 in. Side Return | KGAAD0201MEC | 24"x25" IAQ Devices | | | | | | | | | | |
| **Gas Conversion Accessories** | | | | | | | | | | | | |
| Mobile Home Kit | KGBMH0601KIT | | ● | ● | ● | ● | ● | ● | ● | ● | ● | |
| Gas Conversion Kit - Nat to LP | KGANP54011SP | ● | | | | | | | | | | |
| Gas Conversion Kit - LP to Nat | KGAPN46011SP | ● | | | | | | | | | | |
| Gas Conversion Kit - Nat to LP | KGBNP50011SP | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Conversion Kit - LP to Nat | KGBPN42011SP | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #42 (Nat Gas) | LH32DB207 | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #43 (Nat Gas) | LH32DB202 | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #44 (Nat Gas) | LH32DB200 | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #45 (Nat Gas) | LH32DB205 | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #46 (Nat Gas) | LH32DB208 | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #47 (Nat Gas) | LH32DB078 | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #48 (Nat Gas) | LH32DB076 | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #54 (LP) | LH32DB203 | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #55 (LP) | LH32DB201 | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - #56 (LP) | LH32DB206 | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - 1.25mm (LP) | LH32DB209 | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Gas Orifice Kit - 1.30mm (LP) | LH32DB210 | | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| **Gas Valve Adapter** | | | | | | | | | | | | |
| Gas Valve Tower Port Adapter Kit | 92—1003 | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| **Control Accessories** | | | | | | | | | | | | |
| Twinning Kit | KGATW0701HSI | | | ● | | ● | ● | ● | ● | ● | ● | |
| **IAQ Accessories** | | | | | | | | | | | | |
| Filter Rack — Bottom Return for 1" Filters — 14.2" wide | KGBFR0401B14 | ● | ● | ● | | ● | ● | | ● | ● | | ● |
| Filter Rack — Bottom Return for 1" Filters — 17.5" wide | KGBFR0501B17 | | ● | ● | ● | ● | ● | | ● | ● | | ● |
| Filter Rack — Bottom Return for 1" Filters — 21.0" wide | KGBFR0601B21 | | ● | ● | | ● | ● | ● | ● | ● | | ● |
| Filter Rack — Bottom Return for 1" Filters — 24.5" wide | KGBFR0701B24 | | ● | ● | | ● | ● | | ● | ● | ● | ● |
| Filter Pack (6 pack) — Washable - 16x25x1 | KGAWF1306UFR | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| Filter Pack (6 pack) — Washable - 24x25x1 | KGAWF1506UFR | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● | ● |
| EZ-Flex Filter - 16" (406 mm) | EXPXXFIL0016 | Use with EZXCAB—1016 | | | | | | | | | | |
| EZ-Flex Filter - 20" (508 mm) | EXPXXFIL0020 | Use with EZXCAB—1020 | | | | | | | | | | |
| EZ-Flex Filter - 24" (610 mm) | EXPXXFIL0024 | Use with EZXCAB—1024 | | | | | | | | | | |
| EZ-Flex Filter with End Caps - 16" (406 mm) | EXPXXUNV0016 | Use with EZXCAB—1016 | | | | | | | | | | |
| EZ-Flex Filter with End Caps - 20" (508 mm) | EXPXXUNV0020 | Use with EZXCAB—1020 | | | | | | | | | | |
| EZ-Flex Filter with End Caps - 24" (610 mm) | EXPXXUNV0024 | Use with EZXCAB—1024 | | | | | | | | | | |
| Cartridge Media Filter - 16" (406 mm) | FILXXCAR0016 | Use with FILCABXL—1016 | | | | | | | | | | |
| Cartridge Media Filter - 20" (508 mm) | FILXXCAR0020 | Use with FILCABXL—1020 | | | | | | | | | | |
| Cartridge Media Filter - 24" (610 mm) | FILXXCAR0024 | Use with FILCABXL—1024 | | | | | | | | | | |
| EZ Flex Cabinet Side or Bottom Return 4" Filters — 16" | EZXCABCC0016 | ● | ● | ● | ● | ● | ● | | | | | |
| EZ Flex Cabinet Side or Bottom Return 4" Filters — 20" | EZXCABCC0020 | | | | | | | ● | ● | ● | | |
| EZ Flex Cabinet Side or Bottom Return 4" Filters — 24" | FILCABXL0024 | | | | | | | | | | ● | ● |

● = Used with the model furnace

# AIR DELIVERY – CFM (BOTTOM RETURN WITH FILTER)

| UNIT SIZE | RETURN-AIR CONNECTION | SPEED TAPS [2] | EXTERNAL STATIC PRESSURE (IN. W.C.) [6] | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | | 0.1 | 0.2 | 0.3 | 0.4 | 0.5 | 0.6 | 0.7 | 0.8 | 0.9 | 1.0 |
| 24026 | SIDE/BOTTOM | Black | 1000 | 945 | 895 | 835 | 775 | 705 | 635 | 560 | **485** | **395** |
| | | Yellow | 750 | 695 | 640 | 575 | 515 | 455 | 390 | **315** | **250** | - [7] |
| | | Blue | 675 | 620 | 560 | 500 | 440 | 380 | 310 | **245** | - [7] | - [7] |
| | | Red [5] | 500 | 440 | 375 | 315 | 245 | - [7] | - [7] | - [7] | - [7] | - [7] |
| 30040 | SIDE OR BOTTOM | Black | 1100 | 1055 | 1010 | 960 | **905** | **850** | **795** | **740** | **685** | **620** |
| | | Yellow | 955 | 915 | 875 | 830 | 790 | 740 | 695 | 645 | 590 | **530** |
| | | Blue | 820 | 795 | 765 | 730 | 695 | 655 | 615 | 570 | 515 | **460** |
| | | Red | 730 | 710 | 680 | 655 | 625 | 595 | 555 | 515 | 465 | **400** |
| 36040 | SIDE OR BOTTOM | Black | 1245 | 1195 | 1150 | 1100 | 1050 | **1000** | **945** | **890** | **830** | **775** |
| | | Yellow | 1165 | 1120 | 1075 | 1030 | 980 | 925 | 870 | 815 | 760 | 710 |
| | | Orange | 1045 | 1015 | 965 | 925 | 885 | 840 | 790 | 740 | 695 | 640 |
| | | Blue | 1000 | 960 | 930 | 890 | 850 | 810 | 765 | 715 | 665 | 615 |
| | | Red | 735 | 725 | 700 | 680 | 650 | 625 | 590 | 555 | 515 | **470** |
| 30060 | SIDE OR BOTTOM | Black | 1340 | 1295 | 1245 | 1190 | 1130 | 1065 | 1005 | **895** | **815** | **725** |
| | | Yellow | 1035 | 1010 | 980 | 945 | 910 | 865 | 795 | 730 | 665 | 605 |
| | | Blue | 845 | 825 | 810 | 785 | 755 | 710 | 670 | 625 | 570 | 515 |
| | | Red [5] | 770 | 750 | 730 | 710 | 675 | 640 | 600 | 560 | 510 | **455** |
| 42060 | SIDE OR BOTTOM | Black | 1665 | 1615 | 1550 | 1485 | 1420 | 1345 | 1270 | 1190 | 1105 | **985** |
| | | Yellow | 1340 | 1320 | 1295 | 1260 | 1215 | 1165 | 1110 | 1045 | 925 | 850 |
| | | Orange | 1050 | 1045 | 1035 | 1015 | 995 | 960 | 915 | 845 | 785 | 725 |
| | | Blue | 985 | 980 | 975 | 950 | 930 | 900 | 845 | 795 | 740 | 690 |
| | | Red [5] | 735 | 720 | 700 | 675 | 650 | 620 | 595 | 560 | **520** | **480** |
| 48080 | SIDE OR BOTTOM | Black | 1870 | 1810 | 1740 | 1670 | 1600 | 1525 | 1440 | **1355** | **1270** | **1180** |
| | | Yellow | 1525 | 1495 | 1460 | 1415 | 1365 | 1305 | 1240 | 1170 | 1090 | 990 |
| | | Orange | 1375 | 1355 | 1330 | 1300 | 1260 | 1210 | 1155 | 1090 | 1025 | 940 |
| | | Blue | 1045 | 1040 | 1030 | 1010 | 985 | 960 | 920 | 875 | 825 | 745 |
| | | Red [5] | 880 | 865 | 850 | 835 | 810 | 785 | 750 | 715 | 665 | 605 |
| 60080 | BOTTOM or TWO-SIDES [3,4] | Black | 2360 | 2250 | **2160** | **2065** | **1970** | **1880** | **1785** | **1685** | **1580** | **1455** |
| | | Yellow | 2100 | 2030 | 1960 | 1885 | 1805 | 1720 | 1635 | 1545 | 1440 | 1305 |
| | | Orange | 1840 | 1810 | 1765 | 1725 | 1665 | 1590 | 1515 | 1430 | 1335 | 1240 |
| | | Blue | 1705 | 1685 | 1660 | 1615 | 1570 | 1510 | 1445 | 1370 | 1280 | 1135 |
| | | Red | 1425 | 1410 | 1385 | 1365 | 1335 | 1290 | 1245 | 1190 | 1120 | 1050 |
| 42100 | SIDE OR BOTTOM | Black | 1750 | 1705 | 1660 | 1605 | 1545 | 1475 | 1405 | 1305 | 1220 | 1140 |
| | | Blue | 1550 | 1510 | 1470 | 1430 | 1380 | 1320 | 1245 | 1170 | 1095 | 1015 |
| | | Yellow [5] | 1290 | 1255 | 1220 | 1180 | 1130 | 1075 | 1020 | 960 | 885 | 800 |
| | | Red [5] | 1085 | 1045 | 1010 | 960 | 915 | 865 | 805 | 740 | 665 | 595 |
| 60100 | BOTTOM or TWO-SIDES [3,4] | Black | 2415 | 2330 | **2245** | **2155** | **2065** | **1965** | **1865** | **1760** | **1645** | **1530** |
| | | Yellow | 2130 | 2075 | 2010 | 1945 | 1865 | 1785 | 1695 | 1600 | 1490 | 1375 |
| | | Orange | 1830 | 1815 | 1785 | 1740 | 1685 | 1625 | 1550 | 1470 | 1370 | 1255 |
| | | Blue | 1690 | 1680 | 1655 | 1620 | 1580 | 1530 | 1465 | 1385 | 1295 | 1185 |
| | | Red | 1415 | 1405 | 1390 | 1370 | 1345 | 1305 | 1260 | 1200 | 1125 | 1050 |
| 60120 | BOTTOM or TWO-SIDES [3,4] | Black | 2440 | 2360 | **2295** | **2215** | **2105** | **1975** | **1815** | **1710** | **1575** | **1405** |
| | | Blue | 2300 | 2245 | 2185 | 2090 | 2005 | 1855 | 1745 | 1635 | 1505 | **1370** |
| | | Yellow | 1805 | 1780 | 1750 | 1705 | 1650 | 1595 | 1515 | 1430 | 1330 | 1230 |
| | | Orange [5] | 1560 | 1550 | 1535 | 1505 | 1470 | 1420 | 1360 | 1285 | 1205 | 1130 |
| | | Red [5] | 1390 | 1385 | 1370 | 1345 | 1320 | 1285 | 1230 | 1175 | 1105 | 1035 |
| 60140 | BOTTOM or TWO-SIDES [3,4] | Black | **2410** | **2325** | **2230** | **2135** | **2035** | **1930** | **1820** | **1700** | **1575** | **1445** |
| | | Blue | 2250 | 2175 | 2100 | 2020 | 1930 | 1825 | 1715 | 1600 | 1485 | **1370** |
| | | Yellow [5] | 1740 | 1725 | 1700 | 1660 | 1610 | 1550 | 1470 | 1390 | 1295 | 1190 |
| | | Orange [5] | 1500 | 1495 | 1485 | 1465 | 1435 | 1390 | 1335 | 1265 | 1185 | 1090 |
| | | Red [5] | 1350 | 1345 | 1335 | 1315 | 1290 | 1255 | 1210 | 1150 | 1080 | 995 |

**NOTE**:

1. A filter is required for each return−air inlet. Airflow performance includes a 3/4−in. (19 mm) washable filter media such as contained in a factory−authorized accessory filter rack. See accessory list. To determine airflow performance without this filter, assume an additional 0.1 in. w.c.. available external static pressure.
2. Blower speed taps are not always in the same order. Factory default blower connections are as follows:
   a. Heating airflow − BLUE (also used for Continuous Fan)
   b. Cooling airflow − BLACK (enabled when the Y terminal is energized)
   **ADJUST THE BLOWER SPEED TAPS AS NECESSARY FOR THE PROPER AIR TEMPERATURE RISE FOR EACH INSTALLATION.**
3. Airflows over 1800 CFM require bottom return, two−side return, or bottom and side return. A minimum filter size of 20" x 25" (508 x 635 mm) is required.
4. For upflow applications, air entering from one side into both the side of the furnace and a return air base counts as a side and bottom return.
5. Highlighted areas indicate that this airflow range is below the range allowed for heating. **THESE AIRFLOW RANGES MAY ONLY BE USED FOR COOLING.**
6. All airflows that are shown in **BOLD** exceed 0.58 watts per CFM at the given external static pressure.
7. The "−" entry indicates an unstable operating condition.

# MAXIMUM ALLOWABLE EXPOSED VENT LENGTHS IN UNCONDITIONED SPACE – FT.

| Winter Design Temp °F | Unit Size | 26,000* BTUH | | | | | |
|---|---|---|---|---|---|---|---|
| | | 0" Insulation | | 3/8" Insulation | | 1/2" Insulation | |
| | Pipe Dia. In. | 1½ | 2 | 1½ | 2 | 1½ | 2 |
| | 20 | 20 | 20 | 50 | 45 | 60 | 50 |
| | 0 | 5 | 5 | 25 | 20 | 30 | 25 |
| | -20 | | | 15 | 10 | 20 | 15 |
| | -40 | | | 10 | 5 | 15 | 10 |

| Winter Design Temp °F | Unit Size | 40,000* BTUH | | | | | | | | | 60,000 BTUH | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | Uninsulated | | | 3/8-in. Insulation | | | 1/2-in. Insulation | | | Uninsulated | | | | 3/8-in. Insulation | | | | 1/2-in. Insulation | | | |
| | Pipe Dia. in. | 1 ½ | 2 | 2 ½ | 1 ½ | 2 | 2 ½ | 1 ½ | 2 | 2 ½ | 1 ½ | 2 | 2 ½ | 3 | 1 ½ | 2 | 2 ½ | 3 | 1 ½ | 2 | 2 ½ | 3 |
| | 20 | 20 | 20 | 20 | 20 | 50 | 45 | 20 | 60 | 50 | 20 | 30 | 30 | 25 | 20 | 75 | 65 | 60 | 20 | 85 | 75 | 65 |
| | 0 | 10 | 5 | 5 | 20 | 25 | 20 | 20 | 30 | 25 | 15 | 15 | 10 | 10 | 20 | 40 | 30 | 25 | 20 | 45 | 40 | 30 |
| | -20 | 5 | | | 20 | 15 | 10 | 20 | 20 | 15 | 10 | 5 | | | 20 | 25 | 20 | 15 | 20 | 30 | 25 | 20 |
| | -40 | | | | 15 | 10 | 5 | 15 | 15 | 10 | 5 | | | | 20 | 15 | 15 | 10 | 20 | 20 | 15 | 10 |

| Winter Design Temp °F | Unit Size | 80,000 BTUH | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | Uninsulated | | | | | 3/8-in. Insulation | | | | | 1/2-in. Insulation | | | | |
| | Pipe Dia. in. | 1 ½ | 2 | 2 ½ | 3 | 4 | 1 ½ | 2 | 2 ½ | 3 | 4 | 1 ½ | 2 | 2 ½ | 3 | 4 |
| | 20 | 15 | 40 | 40 | 35 | 30 | 15 | 50 | 90 | 75 | 65 | 15 | 50 | 70 | 70 | 70 |
| | 0 | 15 | 20 | 15 | 10 | 5 | 15 | 50 | 45 | 35 | 30 | 15 | 50 | 50 | 40 | 35 |
| | -20 | 15 | 10 | 5 | | | 15 | 35 | 30 | 20 | 15 | 15 | 40 | 30 | 25 | 15 |
| | -40 | 10 | 5 | | | | 15 | 25 | 20 | 15 | 5 | 15 | 30 | 25 | 20 | 10 |

| Winter Design Temp °F | Unit Size | 100,000 BTUH | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | Uninsulated | | | | 3/8-in. Insulation | | | | 1/2-in. Insulation | | | |
| | Pipe Dia. in. | 2 | 2 ½ | 3 | 4 | 2 | 2 ½ | 3 | 4 | 2 | 2 ½ | 3 | 4 |
| | 20 | 20 | 50 | 40 | 35 | 20 | 80 | 95 | 80 | 20 | 80 | 105 | 90 |
| | 0 | 20 | 20 | 15 | 10 | 20 | 55 | 45 | 35 | 20 | 65 | 55 | 45 |
| | -20 | 15 | 10 | 5 | | 20 | 35 | 30 | 20 | 20 | 45 | 35 | 25 |
| | -40 | 10 | 5 | | | 20 | 25 | 20 | 10 | 20 | 30 | 25 | 15 |

| Winter Design Temp °F | Unit Size | 120,000 BTUH | | | | | | | | | 140,000 BTUH | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | Uninsulated | | | 3/8-in. Insulation | | | 1/2-in. Insulation | | | Uninsulated | | | 3/8-in. Insulation | | | 1/2-in. Insulation | | |
| | Pipe Dia. in. | 2 ½ | 3 | 4 | 2 ½ | 3 | 4 | 2 ½ | 3 | 4 | 2 ½ | 3 | 4 | 2 ½ | 3 | 4 | 2 ½ | 3 | 4 |
| | 20 | 10 | 50 | 40 | 10 | 75 | 95 | 10 | 75 | 105 | 5 | 55 | 50 | 5 | 65 | 105 | 5 | 65 | 125 |
| | 0 | 10 | 20 | 15 | 10 | 55 | 45 | 10 | 65 | 50 | 5 | 25 | 15 | 5 | 65 | 50 | 5 | 65 | 60 |
| | -20 | 10 | 10 | | 10 | 35 | 25 | 10 | 45 | 30 | 5 | 10 | 5 | 5 | 45 | 30 | 5 | 50 | 40 |
| | -40 | 10 | 5 | | 10 | 25 | 15 | 10 | 30 | 20 | 5 | 5 | | 5 | 30 | 20 | 5 | 35 | 25 |

915SA

# MAXIMUM ALLOWABLE EXPOSED VENT LENGTHS IN UNCONDITIONED SPACE – METERS



| Winter Design Temp °C | Unit Size | 26,000* BTUH | | | | | |
|---|---|---|---|---|---|---|---|
| | | 0" Insulation | | 3/8" Insulation | | 1/2" Insulation | |
| | Pipe Dia. mm | 38 | 51 | 38 | 51 | 38 | 51 |
| | -7 | 6.1 | 6.1 | 15.2 | 13.7 | 18.3 | 15.2 |
| | -18 | 1.5 | 1.5 | 7.6 | 6.1 | 9.1 | 7.6 |
| | -29 | | | 4.6 | 3.0 | 6.1 | 4.6 |
| | -40 | | | 3.0 | 1.5 | 4.6 | 3.0 |

| Winter Design Temp °C | Unit Size | 40,000* BTUH | | | | | | | | | 60,000 BTUH | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | Uninsulated | | | 3/8-in. Insulation | | | 1/2-in. Insulation | | | Uninsulated | | | | 3/8-in. Insulation | | | | 1/2-in. Insulation | | | |
| | Pipe Dia. mm | 38 | 51 | 64 | 38 | 51 | 64 | 38 | 51 | 64 | 38 | 51 | 64 | 76 | 38 | 51 | 64 | 76 | 38 | 51 | 64 | 76 |
| | -7 | 6.1 | 6.1 | 6.1 | 6.1 | 15.2 | 13.7 | 6.1 | 18.3 | 15.2 | 6.1 | 9.1 | 9.1 | 7.6 | 6.1 | 22.9 | 19.8 | 18.3 | 6.1 | 25.9 | 22.9 | 19.8 |
| | -18 | 3.0 | 1.5 | 1.5 | 6.1 | 7.6 | 6.1 | 6.1 | 9.1 | 7.6 | 4.6 | 4.6 | 3.0 | 3.0 | 6.1 | 12.2 | 9.1 | 7.6 | 6.1 | 13.7 | 12.2 | 9.1 |
| | -29 | 1.5 | | | 6.1 | 4.6 | 3.0 | 6.1 | 6.1 | 4.6 | 3.0 | 1.5 | | | 6.1 | 7.6 | 6.1 | 4.6 | 6.1 | 9.1 | 7.6 | 6.1 |
| | -40 | | | | 4.6 | 3.0 | 1.5 | 4.6 | 4.6 | 3.0 | 1.5 | | | | 6.1 | 4.6 | 4.6 | 3.0 | 6.1 | 6.1 | 4.6 | 3.0 |

| Winter Design Temp °C | Unit Size | 80,000 BTUH | | | | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | Uninsulated | | | | | 3/8-in. Insulation | | | | | 1/2-in. Insulation | | | | |
| | Pipe Dia. mm | 38 | 51 | 64 | 76 | 102 | 38 | 51 | 64 | 76 | 102 | 38 | 51 | 64 | 76 | 102 |
| | -7 | 4.6 | 12.2 | 12.2 | 10.7 | 9.1 | 4.6 | 15.2 | 27.4 | 22.9 | 19.8 | 4.6 | 15.2 | 21.3 | 21.3 | 21.3 |
| | -18 | 4.6 | 6.1 | 4.6 | 3.0 | 1.5 | 4.6 | 15.2 | 13.7 | 10.7 | 9.1 | 4.6 | 15.2 | 15.2 | 12.2 | 10.7 |
| | -29 | 4.6 | 3.0 | 1.5 | | | 4.6 | 10.7 | 9.1 | 6.1 | 4.6 | 4.6 | 12.2 | 9.1 | 7.6 | 4.6 |
| | -40 | 3.0 | 1.5 | | | | 4.6 | 7.6 | 6.1 | 4.6 | 1.5 | 4.6 | 9.1 | 7.6 | 6.1 | 3.0 |

| Winter Design Temp °C | Unit Size | 100,000 BTUH | | | | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | Uninsulated | | | | 3/8-in. Insulation | | | | 1/2-in. Insulation | | | |
| | Pipe Dia. mm | 51 | 64 | 76 | 102 | 51 | 64 | 76 | 102 | 51 | 64 | 76 | 102 |
| | -7 | 6.1 | 15.2 | 12.2 | 10.7 | 6.1 | 24.4 | 28.9 | 24.4 | 6.1 | 24.4 | 32.0 | 27.4 |
| | -18 | 6.1 | 6.1 | 4.6 | 3.0 | 6.1 | 16.8 | 13.7 | 10.7 | 6.1 | 19.8 | 16.7 | 13.7 |
| | -29 | 4.6 | 3.0 | 1.5 | | 6.1 | 10.7 | 9.1 | 6.1 | 6.1 | 13.7 | 10.7 | 7.6 |
| | -40 | 3.0 | 1.5 | | | 6.1 | 7.6 | 6.1 | 3.0 | 6.1 | 9.1 | 7.6 | 4.6 |

| Winter Design Temp °C | Unit Size | 120,000 BTUH | | | | | | | | | 140,000 BTUH | | | | | | | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| | | Uninsulated | | | 3/8-in. Insulation | | | 1/2-in. Insulation | | | Uninsulated | | | 3/8-in. Insulation | | | 1/2-in. Insulation | | |
| | Pipe Dia. mm | 64 | 76 | 102 | 64 | 76 | 102 | 64 | 76 | 102 | 64 | 76 | 102 | 64 | 76 | 102 | 64 | 76 | 102 |
| | -7 | 3.0 | 15.2 | 12.2 | 3.0 | 22.9 | 28.9 | 3.0 | 22.9 | 32.0 | 1.5 | 16.7 | 15.2 | 1.5 | 19.8 | 32.0 | 1.5 | 19.8 | 38.1 |
| | -18 | 3.0 | 6.1 | 4.6 | 3.0 | 16.8 | 13.7 | 3.0 | 19.8 | 15.2 | 1.5 | 7.6 | 4.6 | 1.5 | 19.8 | 15.2 | 1.5 | 19.8 | 18.3 |
| | -29 | 3.0 | 3.0 | | 3.0 | 10.7 | 7.6 | 3.0 | 13.7 | 9.1 | 1.5 | 3.0 | 1.5 | 1.5 | 13.7 | 9.1 | 1.5 | 15.2 | 12.2 |
| | -40 | 3.0 | 1.5 | | 3.0 | 7.6 | 4.6 | 3.0 | 9.1 | 6.1 | 1.5 | 1.5 | | 1.5 | 9.1 | 6.1 | 1.5 | 35 | 7.6 |

# MAXIMUM EQUIVALENT VENT LENGTHS

**Table 1 – Maximum Equivalent Vent Length – Ft.**

***NOTE: Maximum Equivalent Vent Length (MEVL) includes standard and concentric vent termination and does NOT include elbows. Use Table 2 – Deductions from Maximum Equivalent Vent Length to determine allowable vent length for each application.***

| Unit Size | | 26,000 [2] | | 40,000 [1] | | | 60,000 [2] | | | | 80,000 | | | | | 100,000 | | | | 120,000 | | | 140,000 | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Altitude (feet) | Pipe Dia. (in) | 1 ½ | 2 | 1 ½ | 2 | 2 ½ | 1 ½ | 2 | 2 ½ | 3 | 1 ½ | 2 | 2 ½ | 3 | 4 | 2 | 2 ½ | 3 | 4 | 2 ½ | 3 | 4 | 2 ½ | 3 | 4 |
| | 0–2000 | 70 | 200 | 40 | 155 | 185 | 20 | 100 | 175 | 200 | 15 | 55 | 130 | 175 | 200 | 20 | 80 | 175 | 200 | 10 | 75 | 185 | 5 | 65 | 155 |
| | 2001–3000 | 65 | 190 | 35 | 150 | 175 | | 95 | 165 | 185 | 10 | 49 | 125 | 165 | 185 | 15 | 75 | 165 | 185 | | 70 | 175 | N/A | 60 | 140 |
| | 3001–4000 | 60 | 175 | 30 | 135 | 160 | 16 | 90 | 155 | 175 | | | 115 | 155 | 175 | | | 155 | 175 | 5 | 65 | 165 | | | 120 |
| | 4001–4500 | 55 | 160 | 25 | 130 | 155 | | 85 | 150 | 170 | | 44 | 110 | 150 | 165 | 10 | 70 | | 170 | N/A | 60 | 160 | | 50 | 110 |
| | 4501–5000 | | | | 125 | 145 | 15 | 80 | 145 | 165 | | | | 145 | 160 | | 65 | 150 | 165 | | | | | 45 | 100 |
| | 5001–6000 | 50 | 145 | 20 | 120 | 130 | | 75 | 140 | 155 | | 41 | 100 | 135 | 150 | | | 140 | 155 | | | 155 | | 35 | 80 |
| | 6001–7000 | 45 | 135 | 15 | 110 | 120 | 13 | 70 | 130 | 145 | N/A | 38 | 90 | 125 | 140 | | 60 | 135 | 145 | | 50 | 140 | | 30 | 65 |
| | 7001–8000 | 40 | 120 | 10 | 100 | 110 | 10 | 65 | 120 | 135 | | 36 | | 120 | 125 | N/A | 55 | 125 | 135 | | 46 | 130 | | 25 | 45 |
| | 8001–9000 | 35 | 110 | | 90 | 95 | 5 | 60 | 115 | 125 | | 33 | 80 | 110 | 115 | | 50 | 115 | 125 | | 43 | 120 | | 15 | 30 |
| | 9001–10000 | 30 | 95 | 5 | 80 | 85 | N/A | 55 | 105 | 115 | | 30 | 75 | 100 | 105 | | 45 | 100 | 115 | | 39 | 115 | | 10 | 15 |

Maximum Equivalent Vent Length – Meters

| Unit Size | | 26,000 [2] | | 40,000 [1] | | | 60,000 [2] | | | | 80,000 | | | | | 100,000 | | | | 120,000 | | | 140,000 | | |
|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|---|
| Altitude (meters) | Pipe Dia. (mm) | 38 | 51 | 38 | 51 | 64 | 38 | 51 | 64 | 76 | 38 | 51 | 64 | 76 | 102 | 51 | 64 | 76 | 102 | 64 | 76 | 102 | 64 | 76 | 102 |
| | 0–610 | 21.3 | 60.9 | 12.1 | 47.2 | 56.3 | 6.0 | 30.4 | 53.3 | 60.9 | 4.5 | 16.7 | 39.6 | 53.3 | 60.9 | 6.0 | 24.3 | 53.3 | 60.9 | 3.0 | 22.8 | 56.3 | 1.5 | 19.8 | 47.2 |
| | 611–914 | 19.8 | 57.9 | 10.6 | 45.7 | 53.3 | | 28.9 | 50.2 | 56.3 | 3.0 | 14.9 | 38.1 | 50.2 | 56.3 | 4.5 | 22.8 | 50.2 | 56.3 | | 21.3 | 53.3 | N/A | 18.2 | 42.6 |
| | 915–1219 | 18.2 | 53.3 | 9.1 | 41.1 | 48.7 | 4.8 | 27.4 | 47.2 | 53.3 | | | 35.0 | 47.2 | 53.3 | | | 47.2 | 53.3 | 1.5 | 19.8 | 50.2 | | | 36.5 |
| | 1220–1370 | 16.7 | 48.7 | 7.6 | 39.6 | 47.2 | 4.5 | 25.9 | 45.7 | 51.8 | | 13.4 | 33.5 | 45.7 | 50.2 | 3.0 | 21.3 | | 51.8 | N/A | 18.2 | 48.7 | | 15.2 | 33.5 |
| | 1371–1524 | | | | 38.1 | 44.1 | | 24.3 | 44.1 | 50.2 | | | | 44.1 | 48.7 | | 19.8 | 45.7 | 50.2 | | | | | 13.7 | 30.4 |
| | 1525–1829 | 15.2 | 44.1 | 6.0 | 36.5 | 39.6 | | 22.8 | 42.6 | 47.2 | | 12.4 | 30.4 | 41.1 | 45.7 | | | 42.6 | 47.2 | | | 47.2 | | 10.6 | 24.3 |
| | 1830–2134 | 13.7 | 41.1 | 4.5 | 33.5 | 36.5 | 3.9 | 21.3 | 39.6 | 44.1 | NA | 11.5 | 27.4 | 38.1 | 42.6 | | 18.2 | 41.1 | 44.1 | NA | 15.2 | 42.6 | | 9.1 | 19.8 |
| | 2135–2438 | 12.1 | 36.5 | 3.0 | 30.4 | 33.5 | 3.0 | 19.8 | 36.5 | 41.1 | | 10.9 | | 36.5 | 38.1 | NA | 16.7 | 38.1 | 41.1 | | 14.0 | 39.6 | | 7.6 | 13.7 |
| | 2439–2743 | 10.6 | 33.5 | | 27.4 | 28.9 | 1.5 | 18.2 | 35.0 | 38.1 | | 10.0 | 24.3 | 33.5 | 35.0 | | 15.2 | 35.0 | 38.1 | | 13.1 | 36.5 | | 4.5 | 9.1 |
| | 2744–3048 | 9.1 | 28.9 | 1.5 | 24.3 | 25.9 | NA | 16.7 | 32.0 | 35.0 | | 9.1 | 22.8 | 30.4 | 32.0 | | 13.7 | 30.4 | 35.0 | | 11.8 | 35.0 | | 3.0 | 4.5 |

**NOTES**:

1. Inducer Outlet Restrictor disk (P/N 337683–401; 1.25–in. (32 mm) Dia.) shipped in the loose parts bag or available through Replacement Components required under 10–ft. (3 M) TEVL in all orientations. Required for installations from 0 – 2000 (0 to 610 M) above sea level. Failure to use an outlet restrictor may result in flame disturbances or flame sense lock–out.
2. Inducer Outlet Restrictor disk (P/N 337683–401; 1.25–in. (32 mm) Dia.) shipped in the loose parts bag or available through Replacement Components required for no greater than 5–ft. (1.5 M) TEVL in downflow and horizontal orientations only. Required for installations from 0 – 2000 (0 to 610 M) above sea level.

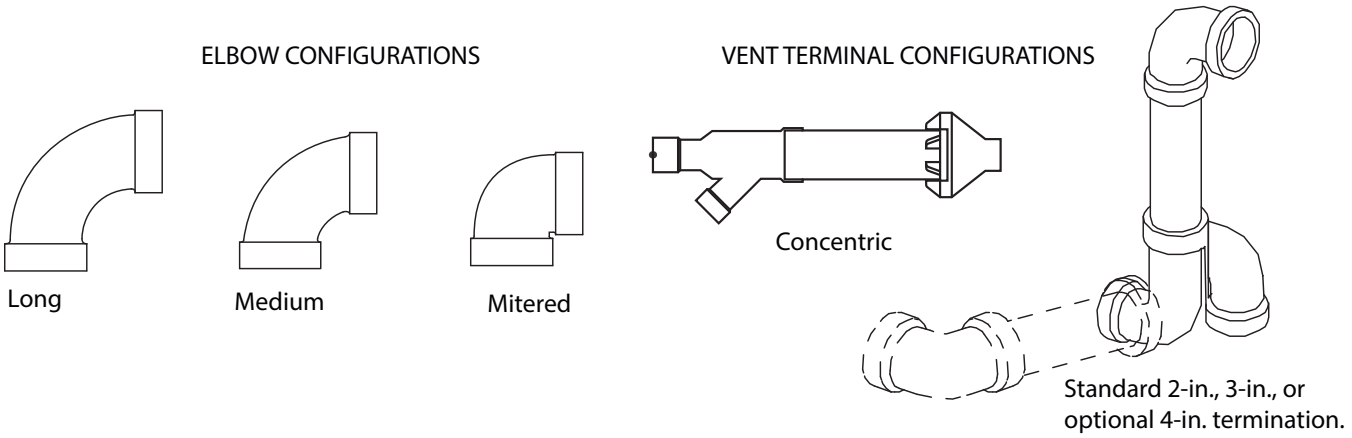


A13110

**Table 2 – Deductions from Maximum Equivalent Vent Length – Ft. (M)**

| Pipe Diameter (in): | 1-1/2 | | 2 | | 2-1/2 | | 3 | | 4 | |
|---|---|---|---|---|---|---|---|---|---|---|
| **Mitered 90º Elbow** | 8 | (2.4) | 8 | (2.4) | 8 | (2.4) | 8 | (2.4) | 8 | (2.4) |
| **Medium Radius 90º Elbow** | 5 | (1.5) | 5 | (1.5) | 5 | (1.5) | 5 | (1.5) | 5 | (1.5) |
| **Long Radius 90º Elbow** | 3 | (0.9) | 3 | (0.9) | 3 | (0.9) | 3 | (0.9) | 3 | (0.9) |
| **Mitered 45º Elbow** | 4 | (1.2) | 4 | (1.2) | 4 | (1.2) | 4 | (1.2) | 4 | (1.2) |
| **Medium Radius 45º Elbow** | 2.5 | (0.8) | 2.5 | (0.8) | 2.5 | (0.8) | 2.5 | (0.8) | 2.5 | (0.8) |
| **Long Radius 45º Elbow** | 1.5 | (0.5) | 1.5 | (0.5) | 1.5 | (0.5) | 1.5 | (0.5) | 1.5 | (0.5) |
| **Tee** | 16 | (4.9) | 16 | (4.9) | 16 | (4.9) | 16 | (4.9) | 16 | (4.9) |

**NOTES**:

1. Use only the smallest diameter pipe possible for venting. Over–sizing may cause flame disturbance or excessive vent terminal icing or freeze–up.
2. NA – Not allowed. Pressure switch will not close, or flame disturbance may result.
3. Vent sizing for Canadian installations over 4500 ft. (1370 M) above sea level are subject to acceptance by the local authorities having jurisdiction.
4. Size both the combustion air and vent pipe independently, then use the larger size for both pipes.
5. Assume the two 45° elbows equal one 90° elbow. Wide radius elbows are desirable and may be required in some cases.
6. Elbow and pipe sections within the furnace casing and at the vent termination should not be included in vent length or elbow count.
7. The minimum pipe length is 5 ft. (2 M) linear feet (meters) for all applications.
8. Use 3–in. (76 mm) diameter vent termination kit for installations requiring 4–in. (102 mm) diameter pipe.

## Venting System Length Calculations

The Total Equivalent Vent Length (TEVL) for **EACH** combustion air or vent pipe equals the length of the venting system, plus the equivalent length of elbows used in the venting system from Table 2.

Standard vent terminations or factory accessory concentric vent terminations count for zero deduction.

See vent system manufacturer's data for equivalent lengths of flexible vent pipe or other termination systems. **DO NOT ASSUME** that one foot of flexible vent pipe equals one foot of straight PVC/ABS DWV vent pipe.

Compare the Total Equivalent Vent Length to the Maximum Equivalent Vent Lengths in Table 1.

## Example 1

A direct-vent 60,000 BTUH furnace installed at 2100 ft. (640M). Venting system includes **FOR EACH PIPE:**
70 feet (22 M) of vent pipe, 65 feet (20 M) of combustion air inlet pipe, (3) 90º long-radius elbows, (2) 45º long-radius elbows, and a factory accessory concentric vent kit.

Can this application use 2" (50 mm ND) PVC/ABS DWV vent piping?

| | | | | | | |
|---|---|---|---|---|---|---|
| Measure the required linear length of air inlet and vent pipe; insert the longest of the two here | | | | | 70 ft. (22 M) | Use length of the longer of the vent or air inlet piping system |
| Add equiv length of (3) 90º long-radius elbows (use the highest number of elbows for either the vent or inlet pipe) | 3 | x | 3 ft. (0.9 M) | = | 9 ft. (2.7 M) | From Table 2 |
| Add equiv length of (2) 45º long-radius elbows (use the highest number of elbows for either the vent or inlet pipe) | 2 | x | 1.5 ft. (0.5 M) | = | 3 ft. (0.9 M) | From Table 2 |
| Add equiv length of factory concentric vent term | | | | | 0 ft. | From Table 2 |
| Add correction for flexible vent pipe, if any | | | | | 0 ft. | From Vent Manufacturer's instructions; zero for PVC/ABS DWV |
| Total Equivalent Vent Length (TEVL) | | | | | 82 ft. (25 M) | Add all of the above lines |
| | | | | | | |
| Maximum Equivalent Vent Length (MEVL) | | | | | 95 ft. (29 M) | For 2" pipe from Table 1 |
| **Is TEVL less than MEVL?** | | | | | **YES** | **Therefore, 2" pipe MAY be used** |

## Example 2

A direct-vent 60,000 BTUH furnace installed at 2100 ft. (640M). Venting system includes **FOR EACH PIPE:**
100 feet (30 M) of vent pipe, 95 feet (29 M) of combustion air inlet pipe, (3) 90º long-radius elbows, and a polypropylene concentric vent kit. Also includes 20 feet (6.1 M) of flexible polypropylene vent pipe, included within the 100 feet (30 M) of vent pipe.

VERIFY FROM POLYPROPYLENE VENT MANUFACTURER'S INSTRUCTIONS for the multiplier correction for flexible vent pipe.

Can this application use 60mm o.d. (2") polypropylene vent piping? If not, what size piping can be used?

| | | | | | | |
|---|---|---|---|---|---|---|
| Measure the required linear length of **RIGID** air inlet and vent pipe; insert the longest of the two here: 100 ft. Of rigid pipe – 20 ft. Of flexible pipe | | | | = | 80 ft. (24 M) | Use length of the longer of the vent or air inlet piping system |
| Add equiv length of (3) 90º long-radius elbows (use the highest number of elbows for either the vent or inlet pipe) | 3 | x | 5 ft. (1.5 M) | = | 15 ft. (4.6 M) | Example from polypropylene vent manufacturer's instructions, Verify from vent manufacturer's instructions. |
| Add equiv length of 45º long-radius elbows (use the highest number of elbows for either the vent or inlet pipe) | 0 | x | | = | 0 ft. (0 M) | |
| Add equiv length of factory concentric vent term | 9 | x | 3.3 ft (0.9 M) | = | 30 ft. (9 M) | |
| Add correction for flexible vent pipe, if any | 2* | x | 20 ft. (6.1 M) | = | 40 ft. (12.2 M) | |
| * VERIFY FROM VENT MANUFACTURER'S INSTRUCTIONS; For example only, assume 1 meter of flexible 60mm (2") or 80mm (3") polypropylene pipe equals 2.0 meters (6.5 ft.) of PVC/ABS pipe. | | | | | | |
| Total Equivalent Vent Length (TEVL) | | | | | 165 ft. (50 M) | Add all of the above lines |
| | | | | | | |
| Maximum Equivalent Vent Length (MEVL) | | | | | 95 ft. (29 M) | For 2" pipe from Table 1 |
| **Is TEVL less than MEVL?** | | | | | **NO** | **Therefore, 60mm (2") pipe may NOT be used; try 80mm (3")** |
| | | | | | | |
| Maximum Equivalent Vent Length (MEVL) | | | | | 185 ft. (57 M) | For 3" pipe from Table 1 |
| **Is TEVL less than MEVL?** | | | | | **YES** | **Therefore, 80mm (3") pipe MAY be used** |

## RETURN AIR TEMPERATURE

This furnace is designed for continuous return−air minimum temperature of 60°F (15°C) db or intermittent operation down to 55°F (13°C) db such as when used with a night setback thermometer. Return−air temperature must not exceed 80°F (27°C) db. Failure to follow these return air limits may affect reliability of heat exchangers, motors and controls.

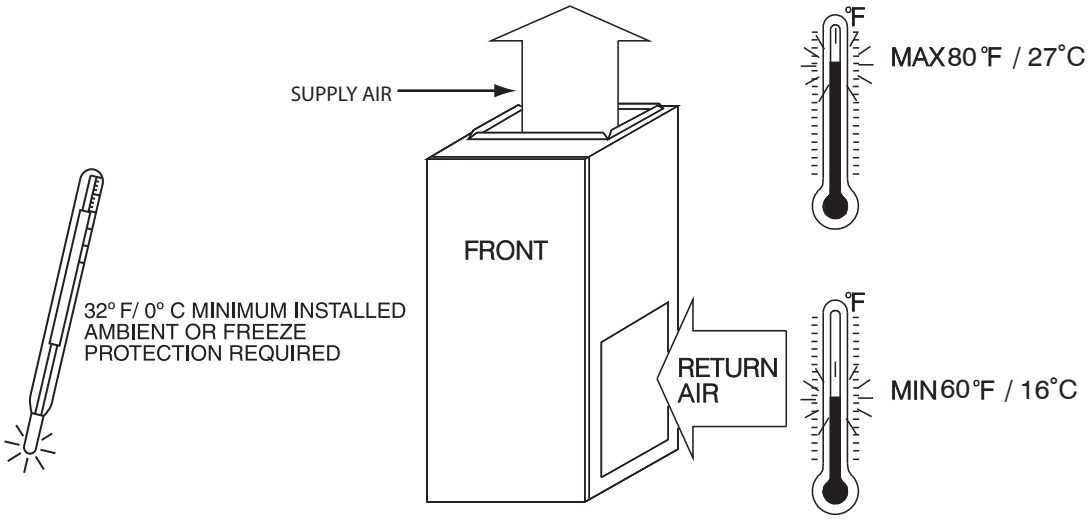


A10490

915SA

## MINIMUM CLEARANCES TO COMBUSTIBLE MATERIALS

| POSITION | CLEARANCE |
|---|---|
| Rear | 0 (0 mm) |
| Front (Combustion air openings in furnace and in structure) | 1 in. (25 mm) |
| Required for service** | 24 in. (610 mm)* |
| All Sides of Supply Plenum** | 1 in. (25 mm) |
| Sides | 0 (0 mm) |
| Vent | 0 (0 mm) |
| Top of Furnace | 1 in. (25 mm) |

* Recommended

**Consult your local building codes

## COMBUSTION−AIR PIPE FOR NON−DIRECT (1−PIPE) VENT APPLICATION

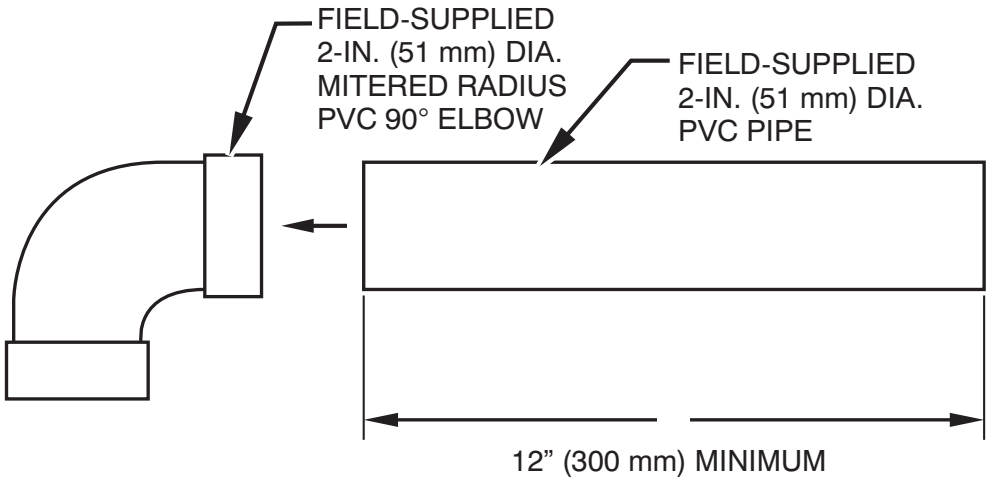


A12376

**NOTE**: See Installation Instructions for specific venting configurations.

# DOWNFLOW SUBBASE

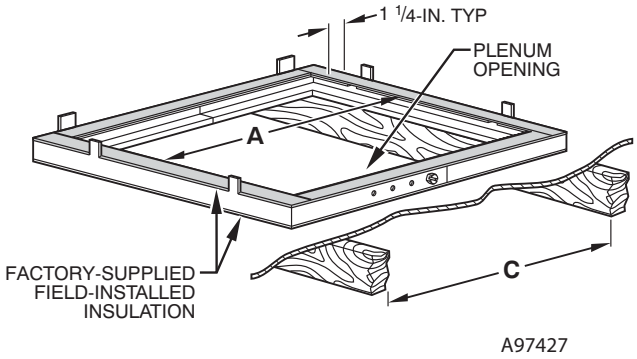


Assembled

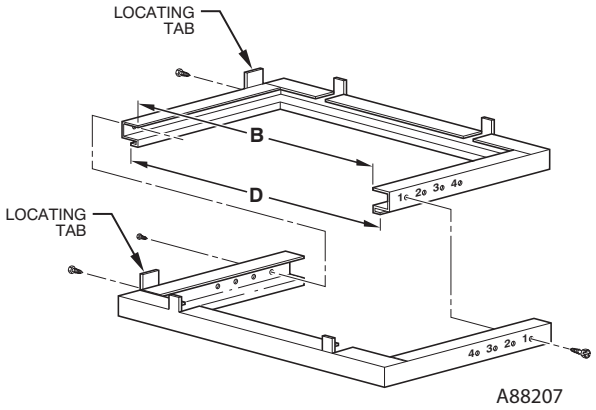


Disassembled



| DIMENSIONS (IN. / MM) | | | | | | |
|---|---|---|---|---|---|---|
| FURNACE CASING WIDTH | FURNACE IN DOWNFLOW APPLICATION | PLENUM OPENING* | | FLOOR OPENING | | HOLE NO. FOR WIDTH ADJUSTMENT |
| | | A | B | C | D | |
| 14−3/16 (360) | Furnace with or without Cased Coil Assembly or Coil Box | 11−3/16 (322) | 19 (483) | 13−7/16 (341) | 20−5/8 (600) | 4 |
| 17−1/2 (445) | Furnace with or without Cased Coil Assembly or Coil Box | 15−1/8 (384) | 19 (483) | 16−3/4 (426) | 20−5/8 (600) | 3 |
| 21 (533) | Furnace with or without Cased Coil Assembly or Coil Box | 18−5/8 (396) | 19 (483) | 20−1/4 (514) | 20−5/8 (600) | 2 |
| 24−1/2 (622) | Furnace with or without Cased Coil Assembly or Coil Box | 22−1/8 (562) | 19 (483) | 23−3/4 (603) | 20−5/8 (600) | 1 |

*The plenum should be constructed 1/4−in. (6 mm) smaller in width and depth than the plenum dimensions shown above.

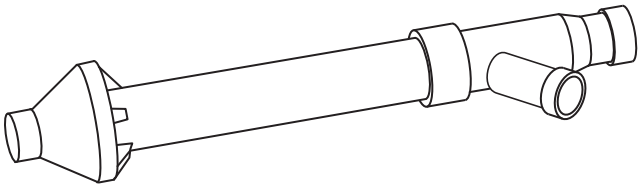

**Concentric Vent Kit**

A93086

A concentric vent kit allows vent and combustion−air pipes to terminate through a single exit in a roof or side wall. One pipe runs inside the other allowing venting through the inner pipe and combustion air to be drawn in through the outer pipe.

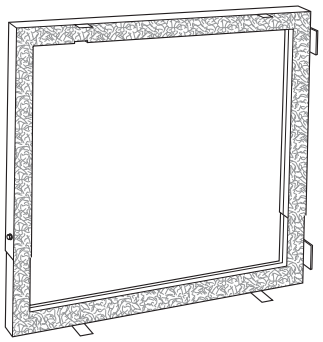

**Downflow Subbase**

A88202

One base fits all furnace sizes. The base is designed to be installed between the furnace and a combustible floor when no coil box is used or when a coil box other than a Bryant cased coil is used. It is CSA design certified for use with Bryant branded furnaces when installed in downflow applications.

## MEDIA FILTER CABINET

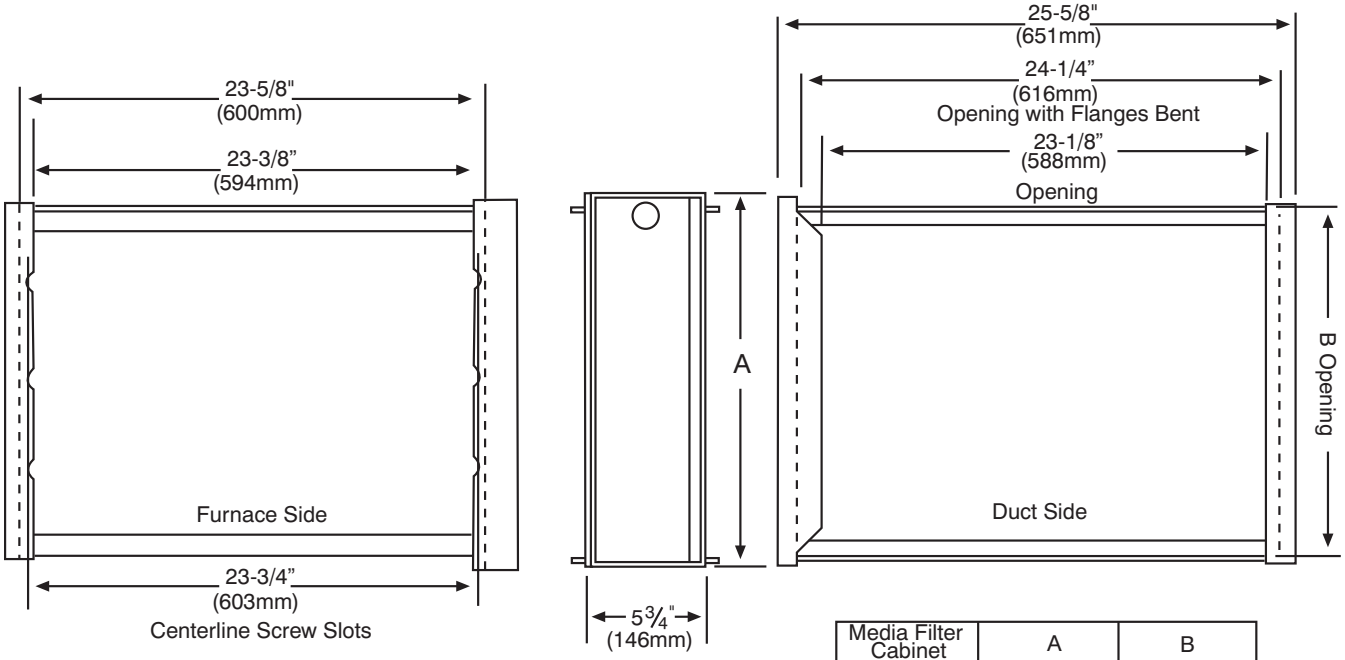


| Media Filter Cabinet | A | B |
|---|---|---|
| 16" (406mm) | 17" (432mm) | 16" (406mm) |
| 20" (508mm) | 21" (533mm) | 20" (508mm) |
| 24" (610mm) | 25" (635mm) | 24" (610mm) |

NOTE: Media cabinet is matched to the bottom opening on furnace. May also be used for side return.

A12428

915SA

## TYPICAL WIRING SCHEMATIC

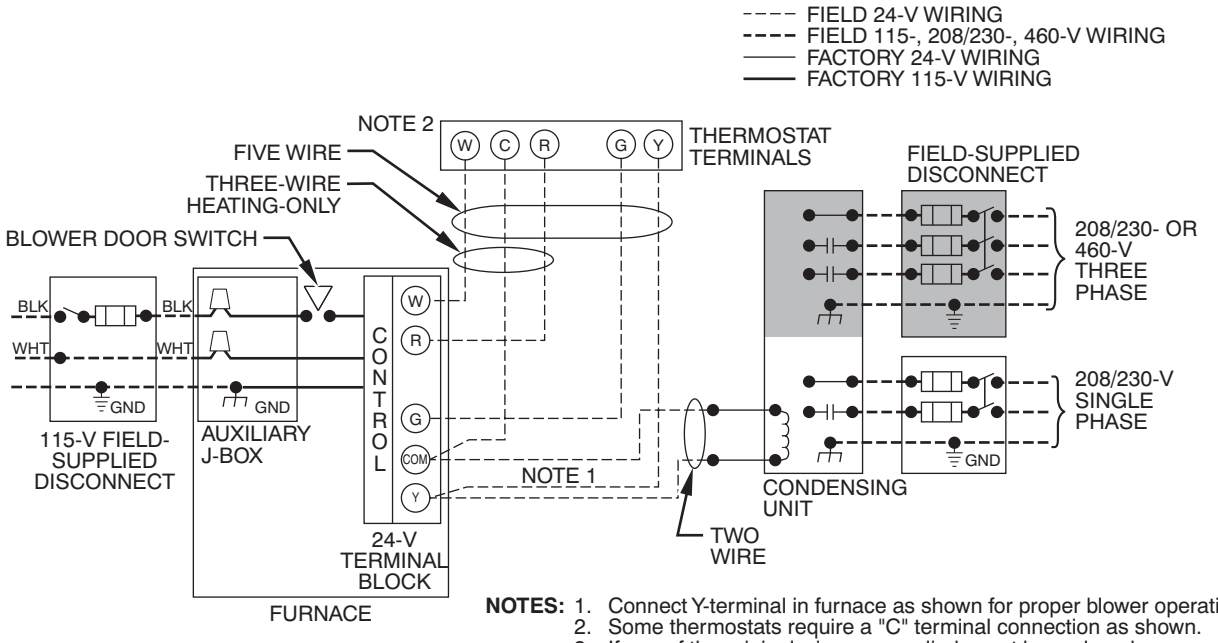


**NOTES:** 1. Connect Y-terminal in furnace as shown for proper blower operation.
2. Some thermostats require a "C" terminal connection as shown.
3. If any of the original wire, as supplied, must be replaced, use same type or equivalent wire.

A11387

# DIMENSIONAL DRAWING

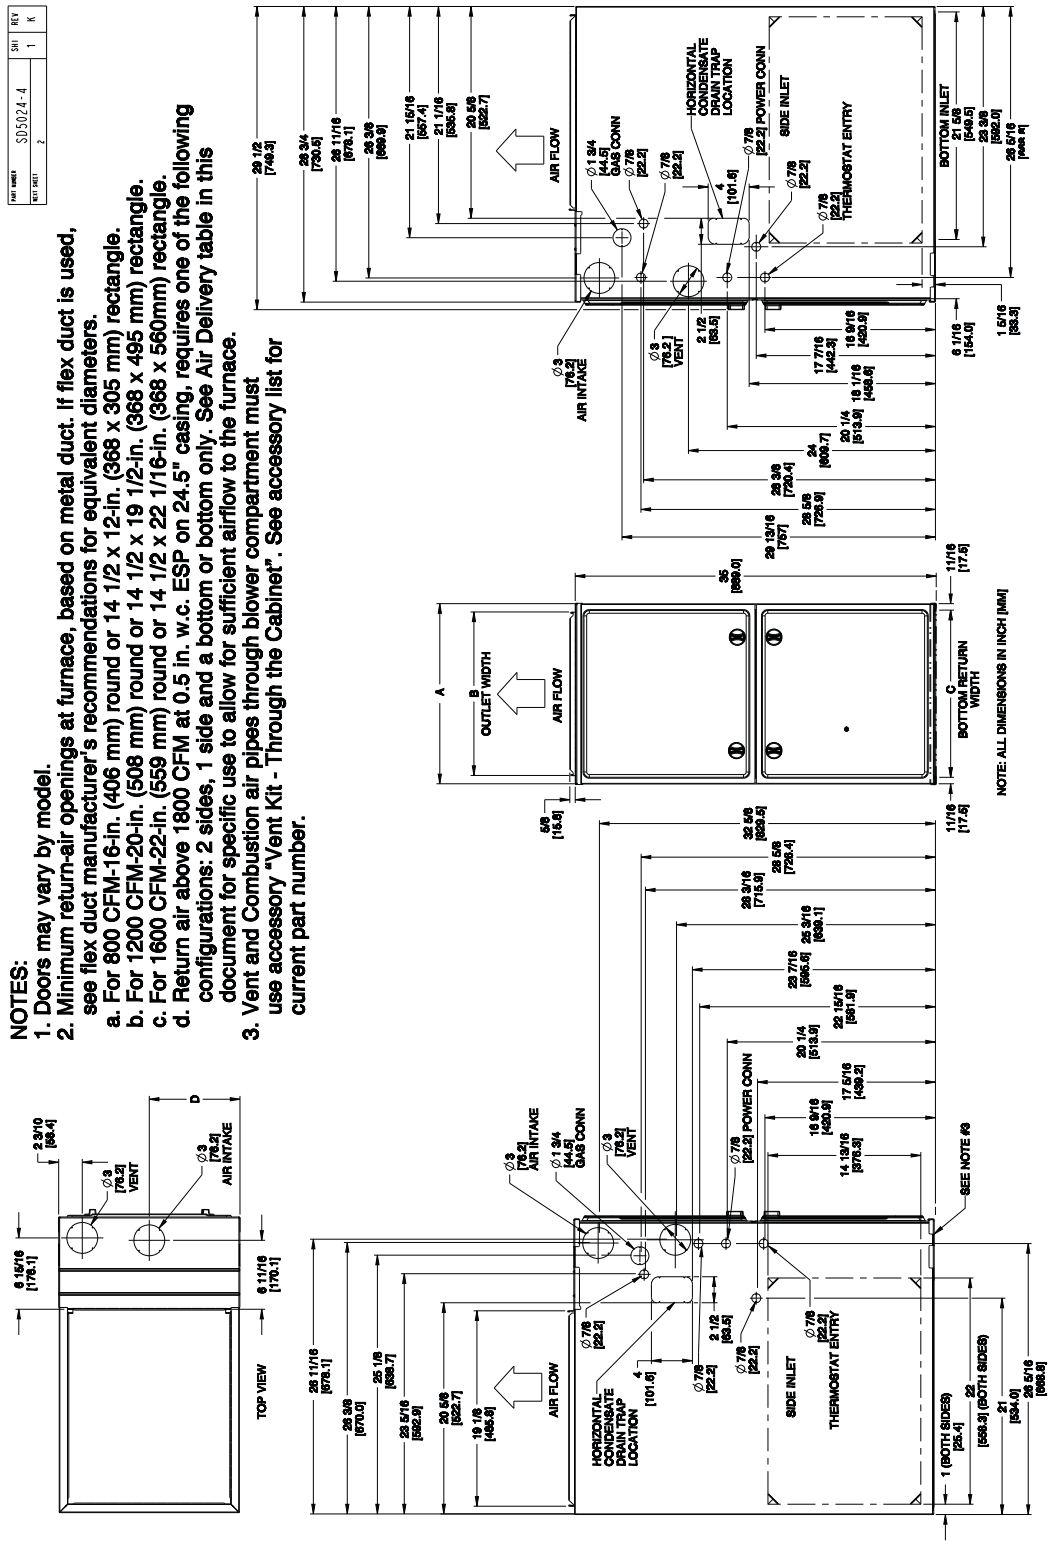


A180302

| FURNACE SIZE | A | B | C | D | SHIP WT. |
|---|---|---|---|---|---|
| | CABINET WIDTH | OUTLET WIDTH | BOTTOM INLET WIDTH | AIR INTAKE | LB (KG) |
| 24026 | 14–3/16 (361) | 12–1/2 (319) | 12–9/16 (322) | 7–1/8 (181) | 118.0 (53.5) |
| 30040 | 14–3/16 (361) | 12–1/2 (319) | 12–9/16 (322) | 7–1/8 (181) | 123.0 (55.4) |
| 36040 | | | | | 127.0 (57.2) |
| 30060 | 17–1/2 (445) | 15–7/8 (403) | 16 (406) | 8–3/4 (222) | 134.0 (60.9) |
| 42060 | | | | | 144.0 (65.4) |
| 48080 | | | | | 154.0 (70.0) |
| 60080 | 21 (533) | 19–3/8 (492) | 19–1/2 (495) | 10–1/2 (267) | 161.5 (73.4) |
| 42100 | | | | | 168.5 (76.6) |
| 60100 | | | | | 168.5 (76.6) |
| 60120 | 24–1/2 (622) | 22–7/8 (581) | 23 (584) | 12–1/4 (311) | 186.0 (84.5) |
| 60140 | | | | | 190.0 (86.4) |

# GUIDE SPECIFICATIONS

## General

### System Description

Furnish a _____ 4−way multipoise gas−fired condensing furnace for use with natural gas or propane (factory−authorized conversion kit required for propane).

### Quality Assurance

Unit will be designed, tested and constructed to the current ANSI Z 21.47/CSA 2.3 design standard for gas−fired central furnaces.

Unit will be third party certified by CSA to the current ANSI Z 21.47/CSA 2.3 design standard for gas−fired central furnaces. Unit will carry the CSA Blue Star® and Blue Flame® labels. Unit efficiency testing will be performed per the current DOE test procedure as listed in the Federal Register.

Unit will be certified for capacity and efficiency and listed in the latest AHRI Consumer's Directory of Certified Efficiency Ratings.

Unit will carry the current Federal Trade Commission Energy Guide efficiency label.

### Delivery, Storage, and Handling

Unit will be shipped as single package only and is stored and handled per unit manufacturer's recommendations.

### Warranty (for inclusion by specifying engineer)

U.S. and Canada only. Warranty certificate available upon request.

### Equipment

Blower Wheel and PSC Blower Motor

Galvanized blower wheel shall be centrifugal type, statically and dynamically balanced. Blower motor of PSC type shall be permanently lubricated with sleeve bearings, of _____hp, and have multiple speeds from 500−1150 RPM operating only when 115−VAC motor inputs are provided. Blower motor shall be direct drive and soft mounted to the blower housing to reduce vibration transmission.

Filters

Furnace shall have reusable−type filters. Filter shall be _____ in. (mm) X _____ in. (mm). An accessory highly efficient Media Filter is available as an option. _____ Media Filter.

Casing

Casing shall be of .030 in. thickness minimum, pre−painted steel.

Draft Inducer Motor

Draft inducer motor shall be single−speed PSC design.

Primary Heat Exchangers

Primary heat exchangers shall be 3−Pass corrosion−resistant aluminized steel of fold−and−crimp sectional design and applied operating under negative pressure.

Secondary Heat Exchangers

Secondary heat exchangers shall be of a stainless steel flow−through of fin−and−tube design and applied operating under negative pressure.

Controls

Controls shall include a micro−processor−based integrated electronic control board with at least 16 service troubleshooting codes displayed via diagnostic flashing LED light on the control, a self−test feature that checks all major functions of the furnace, and a replaceable automotive−type circuit protection fuse. Multiple operational settings available including blower speeds for heating and cooling. Continuous fan speed is the same as the selected heating speed.

### Operating Characteristics

Heating capacity shall be _____ Btuh input; _____ Btuh output capacity.

Fuel Gas Efficiency shall be _____AFUE.

Air delivery shall be _____ cfm minimum at 0.50 in. W.C. external static pressure.

Dimensions shall be: depth_____in. (mm); width _____in. (mm); height_____in. (mm) (casing only). Height shall be_____in. (mm) with A/C coil and _____in. (mm) overall with plenum.

### Electrical Requirements

Electrical supply shall be 115 volts, 60 Hz, single−phase (nominal). Minimum wire size shall be _____AWG; maximum fuse size of HACR−type designated circuit breaker shall be _____ amps.

### Special Features

Refer to section of the product data identifying accessories and descriptions for specific features and available enhancements.

©2018 Bryant Heating & Cooling Systems ● 7310 W. Morris St. ● Indianapolis, IN 46231
Edition Date: 09/18

**Catalog No. PDS915SA—13**

**Manufacturer reserves the right to discontinue, or change at any time, specifications or designs without notice and without incurring obligations.**

Replaces: PDS915SA—12